


PROVIDE 1'-6" SQ. BY 4" THICK
CONCRETE PAD, IF SPECIFIED.

CAST IRON
TOP SECTION WITH "W"
CAST IN TOP SURFACE.

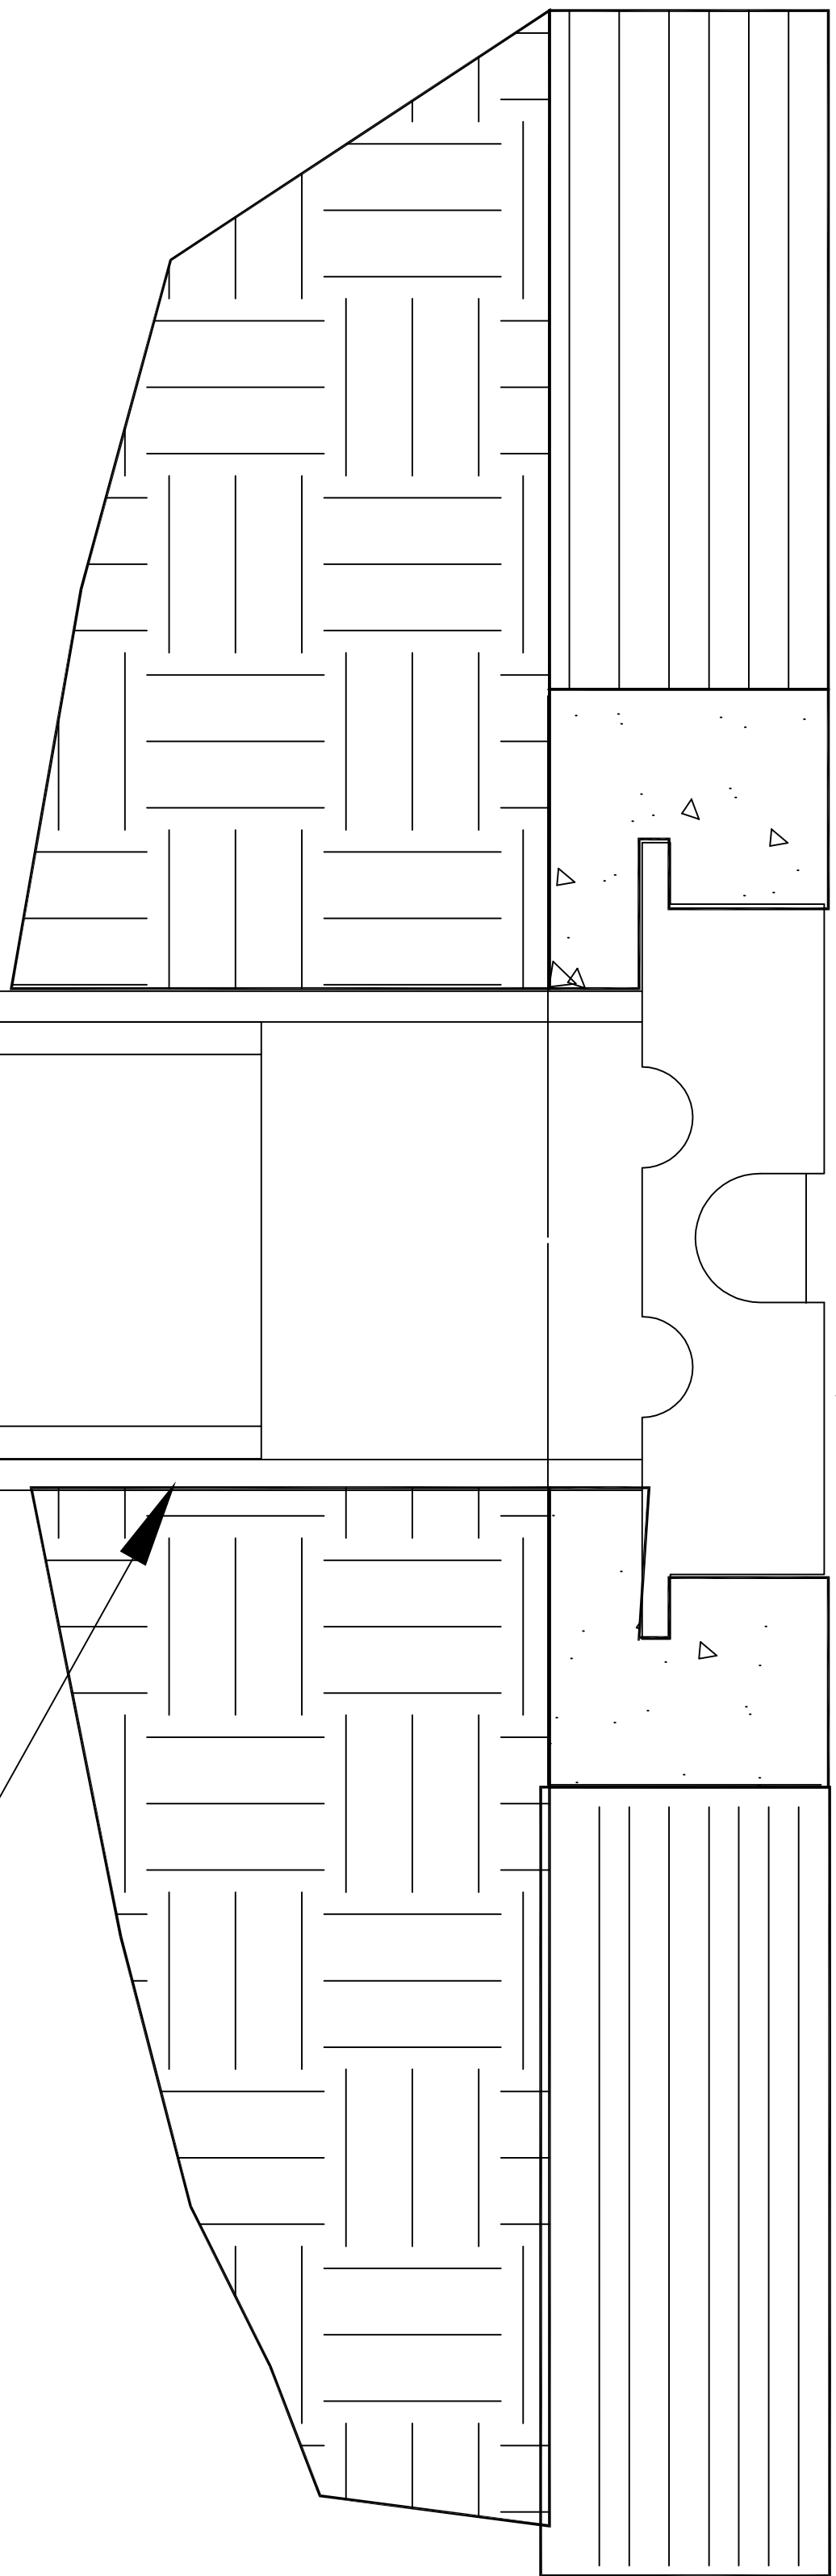

HAND TAMP BACKFILL
AROUND TOP SECTION

AWWA C509
RESILIENT SEATED
EPOXY COATED
NRS
2" SQUARE OPERATING NUT/LEFT TURN

ACCEPTABLE VALVES:
CLOW
KENNEDY KEN - SEAL II
M & H STYLE 4067
US PIPE METROSEAL 250
MUELLER A-2360

8" PVC ASTM D-3034

LENGTH AS REQUIRED
6" INCH PVC IS NOT ACCEPTABLE

GATE VALVE

MAIN

VALVE SIZE AND TYPE
AS SPECIFIED OR SHOWN
ON PLANS.

- NOTES:
1. PORTLAND WATER BUREAU STANDARD VALVE BOX AND COVER AS MANUFACTURED BY OLYMPIC FOUNDRY:
8" CAST IRON VALVE BOX BODY/PORTLAND STYLE/#5-603A
8" CAST IRON VALVE BOX LID /PORTLAND STYLE/#5-603B
 2. GRIND OFF WORDS "PORTLAND OR. " LEAVE WORD "WATER".
 3. BITUMINOUS COATING.
 4. ORDER MJ GATE VALVES WITHOUT ACCESSORIES

GATE VALVE & BOX SETTING DETAIL

ENGINEERING
DEPARTMENT
1924 COUNCIL STREET
P.O. BOX 326
FOREST GROVE, OR 97116

city of
forest
grove